

3D VIEW


2+AIR SPACE
RECOMMENDED;
1+MIN. REQ ϕ
FOR DRAINAGE
WALLS

BRICK VENEER

AIR/WATER/VAPOR
BARRIER AS REQ ϕ

CONCRETE MASONRY
BACKUP

RIGID INSULATION

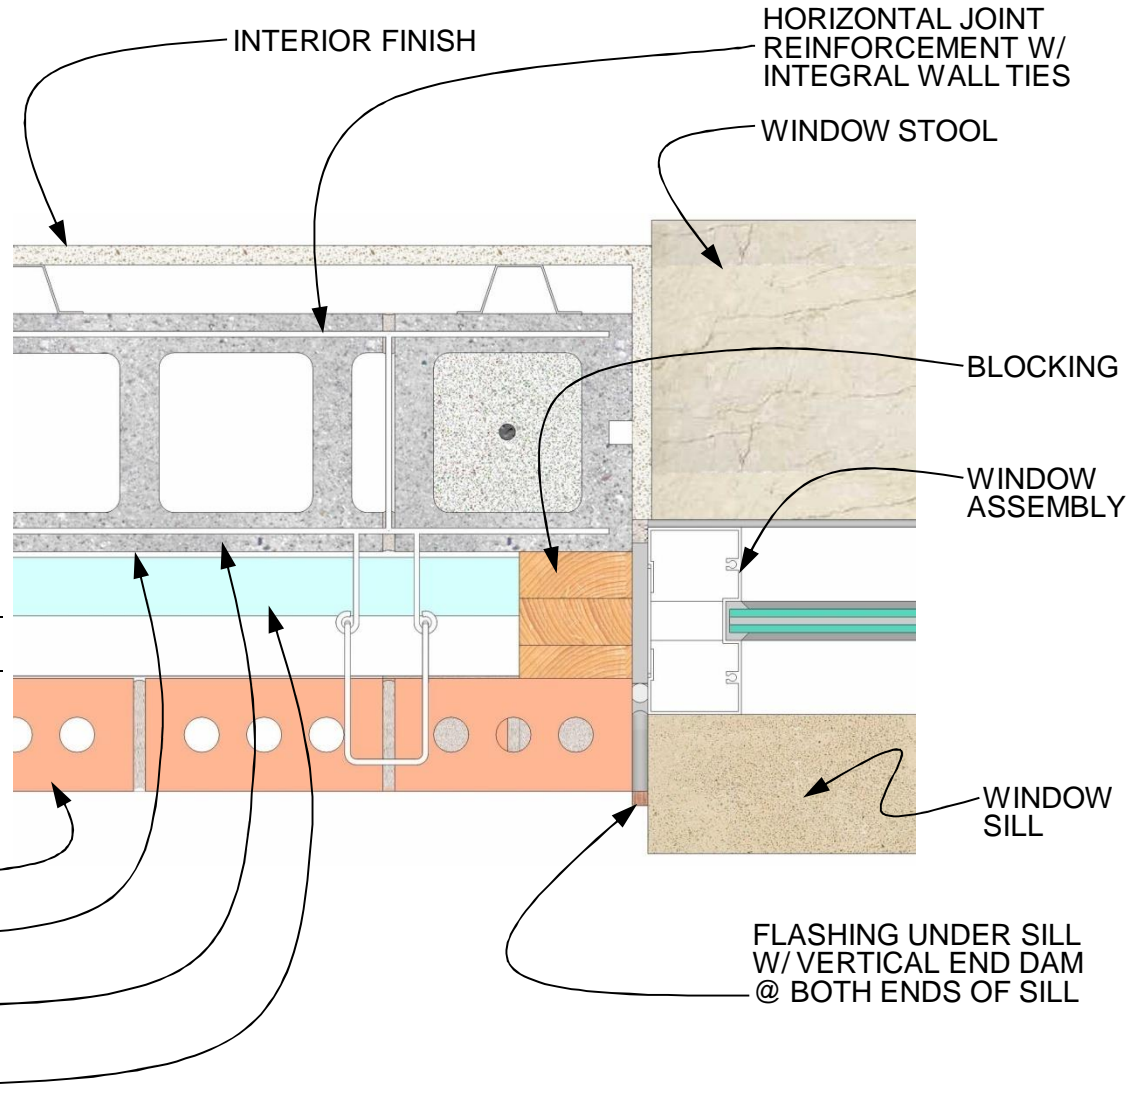

WINDOW JAMB DETAIL

DETAIL 01.030.0502.2D REV. 02/19/08

International Masonry Institute



800-IMI-0988 www.imiweb.org

© 2011 INTERNATIONAL MASONRY INSTITUTE