
2" recommended; 1" minimum per TMS 402 Code 4 1/2" maximum per TMS 402 Code (prescriptive)

Stone Veneer, CMU Backup
Detail 03.030.0201 Rev. 7/28/16

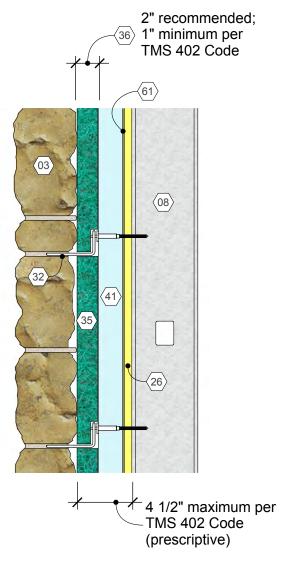

Stone Veneer, Steel Stud Backup Detail 03.040.0201 Rev. 7/28/16

KEY NOTES

- O2 Concrete masonry backup
- (03) Stone veneer
- $\langle 08 \rangle$ Steel studs
- $\langle \overline{26} \rangle$ Sheathing
- Horizontal joint reinforcement
- $\langle 32 \rangle$ Wall tie
- 35 Drainage mat
- Air space for
- drainage; fill w/ drainage mat
- \langle 41 \rangle Cavity insulation
- Air/moisture/vapor barrier as req'd

KEY WORDS

Stone veneer, anchored veneer, cavity wall, air space, drainage, 03.030.0201, 03.040.0201



